





**TYPICAL SIDEWALK  
AGAINST CURB**

Date  
MAY, 2009  
NO SCALE

Revision Date  
MARCH, 2012

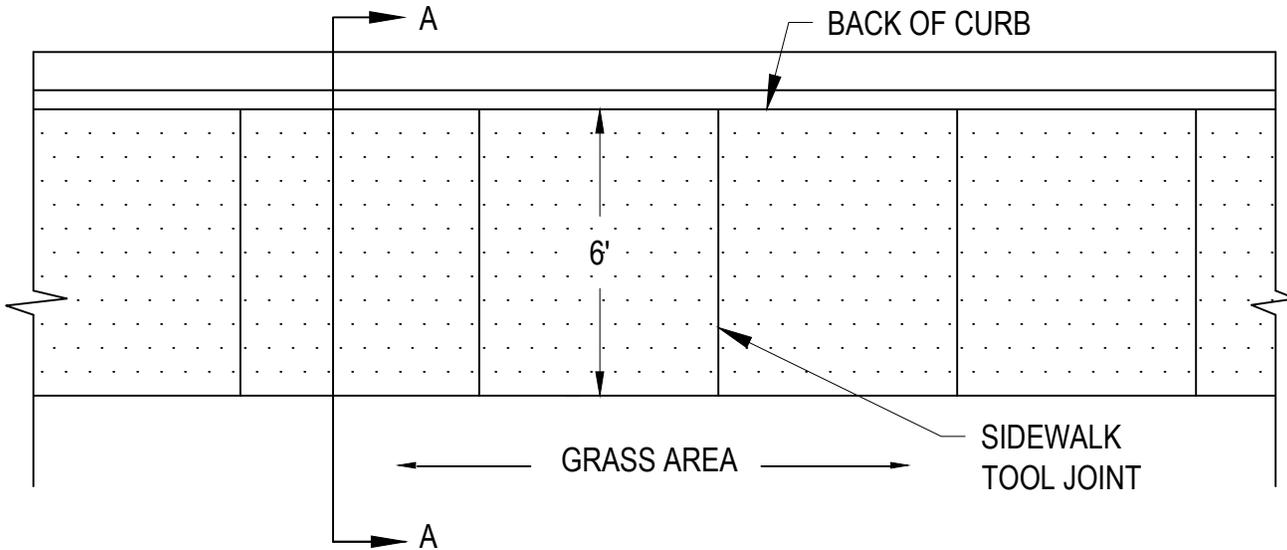

**PLAN VIEW**

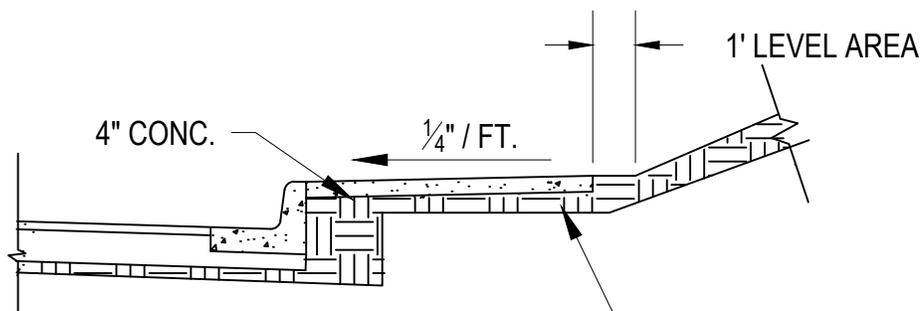

\*\* GREATER THAN 2.0% IF APPROVED BY ENGINEER.

**SECTION A-A'**

COMPACTED SUBGRADE  
6" SUBGRADE TO BE COMPACTED  
TO NOT LESS THAN 95% MAX.  
DENSITY AS PER AHTD

1. 1/2" EXPANSION JOINT SPACING AT 60' AND AT STRUCTURES, DRIVES AND OTHER WALKS.
2. SIDEWALKS SHALL BE TOOLED AT LEAST 20% OF THE FULL DEPTH OF THE SIDEWALK AT 5' INTERVALS.
3. ALL CONCRETE SHALL HAVE 4000 PSI MINIMUM COMPRESSIVE STRENGTH
4. SIDEWALK AGAINST CURB GRANTED ONLY WITH ENGINEER'S PERMISSION